

PULSE™

FLUID MANAGEMENT

3

Settings


graco.com



Login




Settings



Devices

Configure Devices

1.

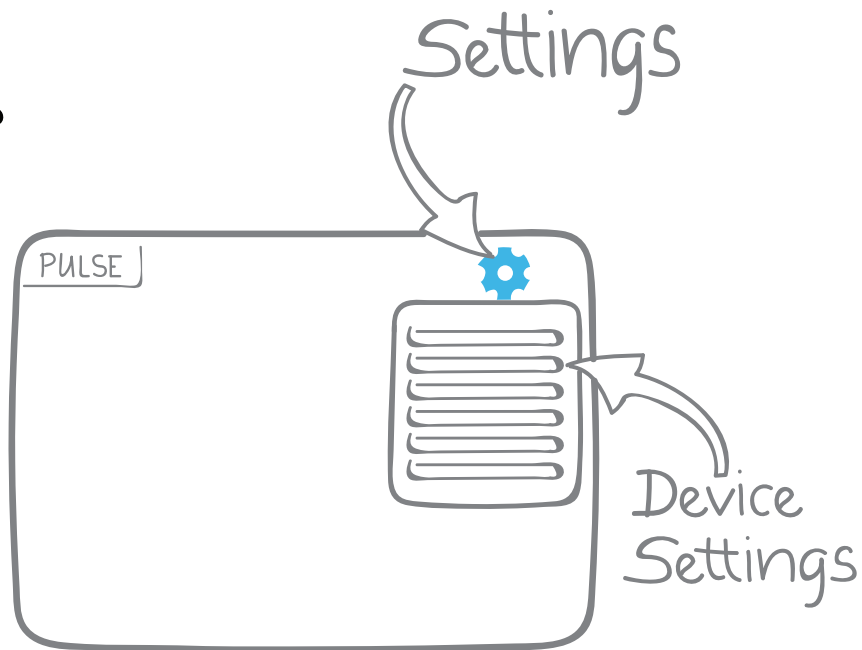

Add/Configure

- Locations
- Fluids
- Tanks
- Meters
- Tank Level Monitors
- Pump Controls

Location/Fluid

2.

+ADD Locations

Location Name

Location Details

+ADD Fluid

Fluid Name

Fluid ID

Tank

3.

+ADD Tank

Units

Capacity

Thresholds

- Low
- High


Low Level Notification

25% 

High Level Notification

75% 

Tank Shape

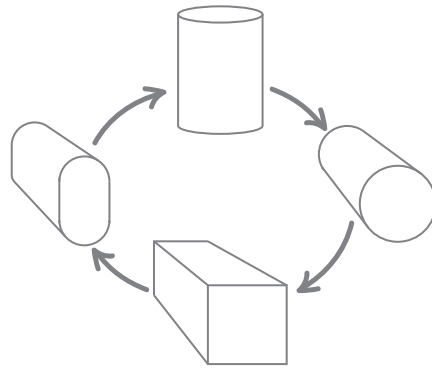

- Length Units
- Dimensions

TLM/Pump Control

4.

🔧 CONFIGURE LEVEL MONITORS

- Low Battery



- Reading Schedule

	12:00	1:00	2:00	3:00
AM	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
PM	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Name _____

5.

🔧 CONFIGURE PUMP CONTROLS

Name _____

Configure Meters

6.

🔧 CONFIGURE METERS

Units

Security

Language

Workorders

- Manual
- Preset
- Fixed Preset

Low Battery

Top Off + Presets

DISCOVER THE PULSE DIFFERENCE



Transparency



Accountability



Integration



Simplicity